



CLR-1PS

Elite Solid State

CURRENT LOOP RELAY INSTRUCTION SHEET

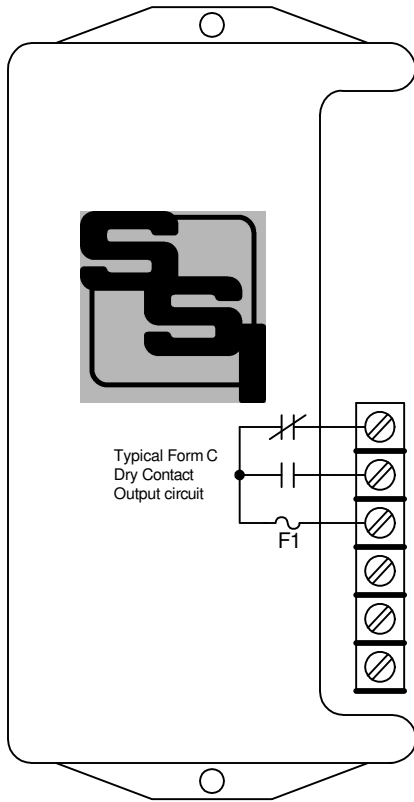

NOTE - The CLR-1PS replaces the RPR-1-SP4 and the CLR-1-S2.

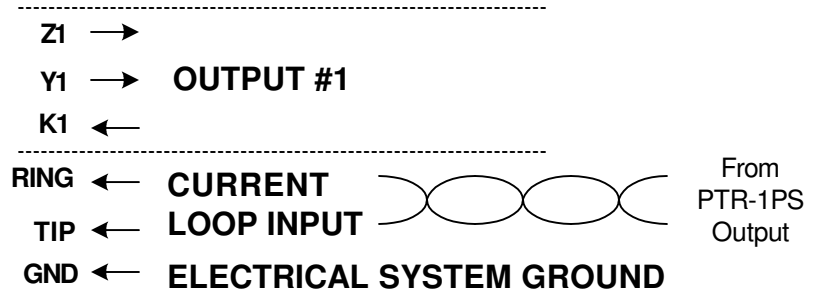


MOUNTING POSITION - The CLR-1PS may be mounted in any position.

INPUT - The CLR-1PS is powered by a +/-24VDC (nominal) current loop from a PTR-1PS Pulse Transmitting Relay. No other power supply to the CLR-1PS is necessary. Connect the CLR-1PS' "RING" terminal to the "RING" output terminal wire of the PTR-1PS. Connect the "TIP" terminal to the "TIP" output terminal wire of the PTR-1PS. The current loop will alternately switch the inputs of the CLR-1PS each time the Yin or Zin terminals are connected to the Kin terminal of the meter. A connection (closure) on the K-Y input of the PTR-1PS results in a closure of the K-Y contacts on the CLR-1PS' outputs. A K-Z closure results in a closure of the K-Z contacts on the CLR-1PS. MOV transient protection on the input is provided internally. Connect the GND terminal to electrical system ground.

FUSES - The fuses are type 3AG and may be up to 1/2 Amp in size. A 1/2 Amp fuses (F1) is supplied standard with the unit unless otherwise specified.


OUTPUT - One 3-wire isolated output is provided on the CLR-1PS, with output terminals K1, Y1 & Z1. MOV transient voltage suppression for the contacts of the solid-state relay is provided internally.



SOLID STATE INSTRUMENTS

a division of Brayden Automation Corp.
6230 Aviation Circle, Loveland, Colorado 80538
Phone: (970)461-9600 Fax: (970)461-9605
E-mail: support@solidstateinstruments.com

PTR-1PS/CLR-xPS System Wiring Diagram

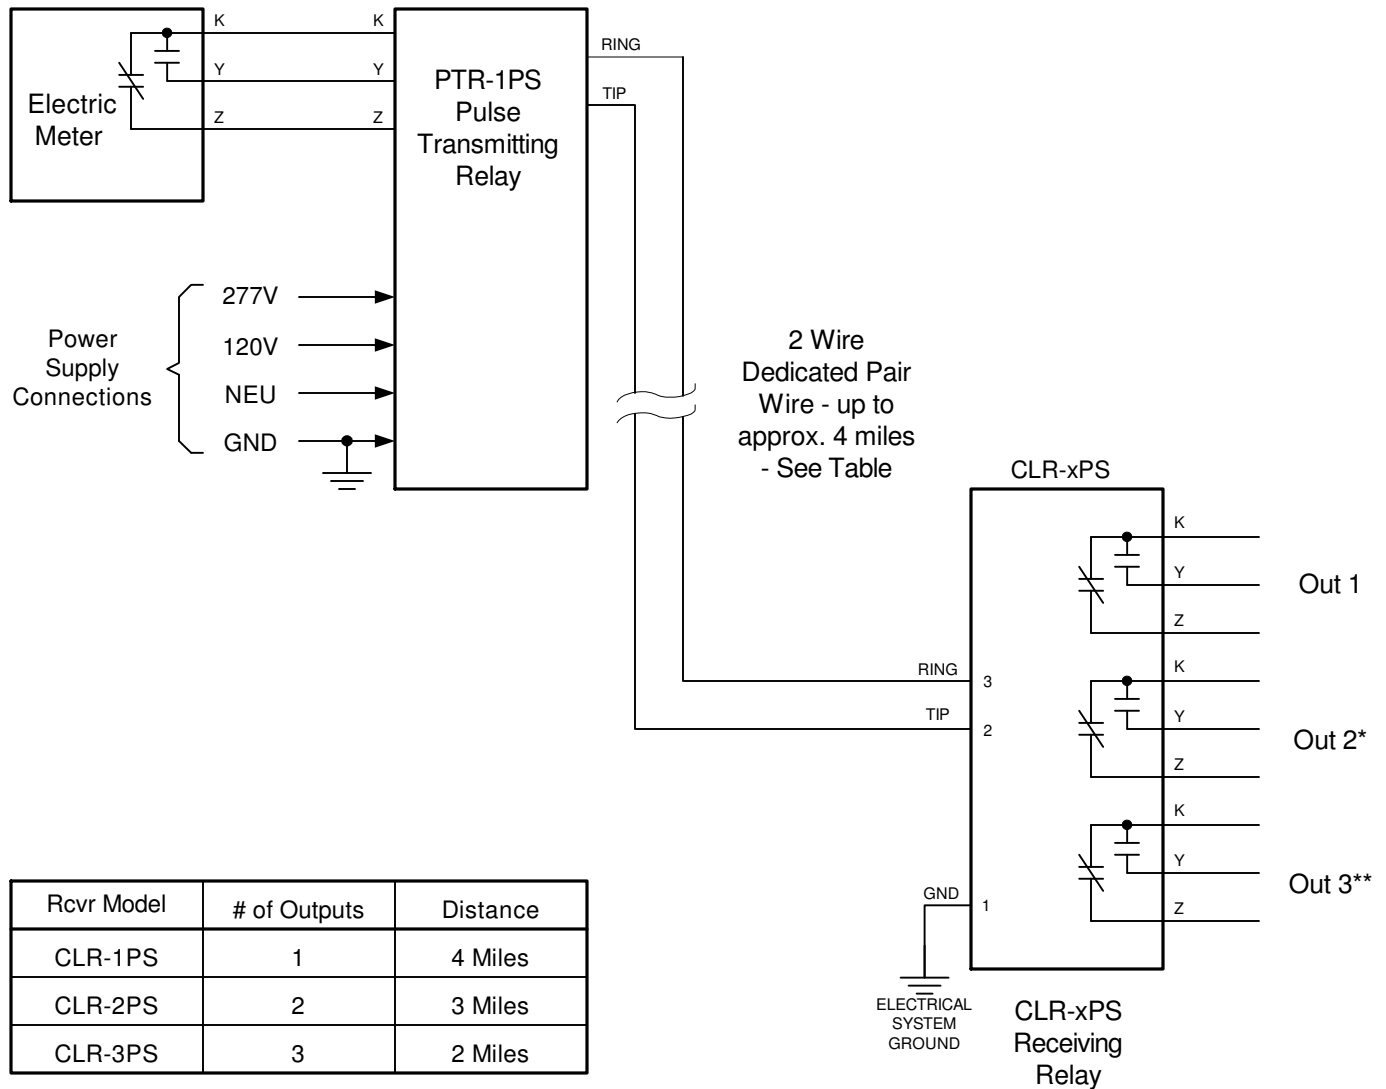

Operation: The PTR-1PS contains a +/-15 to 36VDC current loop for long distance pulse transmission and uses a dedicated pair of wires. As the PTR-1PS' KYZ input alternates from one closure to the other, the current loop polarity reverses causing all output relays to switch in the CLR-xPS Receiving Relay. Maximum distance of transmission decreases with the increased number of outputs on the receiving relay. Maximum distance will also increase as wire size increases.

* CLR-1PS Only
 ** CLR-3PS Only

PTR-1PS to CLR-xPS WiringDiagram.vsd

PTR-1PS Pulse Transmitting Relay Wiring Diagram		REVISIONS		
		NO.	DATE	DESCRIPTION
DATE ORIGINAL	SCALE			
12/09/11	N/A			
LATEST REVISION	JOB NO.	CHECKED	DRAWN	
			WHB	

Brayden Automation Corp./ Solid State Instruments div.
 6230 Aviation Circle
 Loveland, CO 80538
 (970)461-9600
 (970)461-9205 fax
 www.solidstateinstruments.com